




Notes:

- Tanks are constructed from 20-gauge G-90 grade galvanized steel or 304 stainless steel.
- Tops are constructed from 22-gauge G-90 grade galvanized steel or 304 stainless steel.
- All joints to be sealed with Sikaflex-1a, NSF-61 rated for potable water.
- Internal surfaces of the tank to be coated with Sherwin Williams, Macropoxy 646-PW NSF-61 rated.
- ° Optional 12" or 16" stainless steel screened filter basket.
- ° Standard bulkhead fitting thread 3/4", 1 1/4" , or 2".

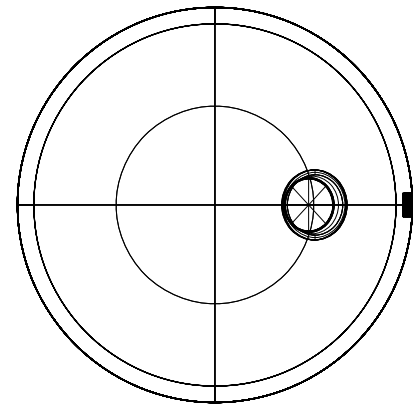

TOP VIEW

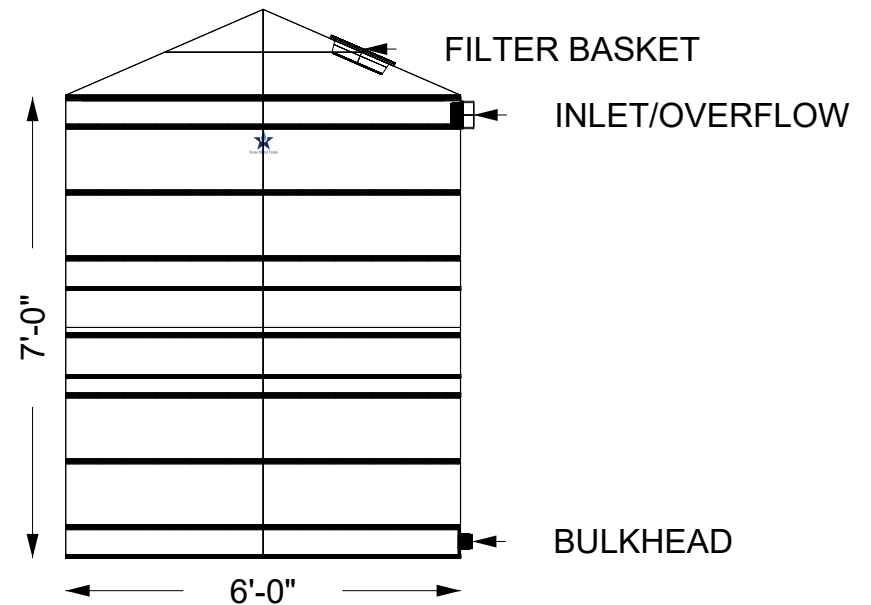

 <p>Texas Metal Tanks</p>	<p>CONTENTS:</p> <p>6'-0" x 7'-0"</p> <p>METAL WATER TANK</p> <p>1480 GAL</p>	
	<p>TEXAS METAL TANKS</p>	
<p>16299 FITZHUGH RD</p> <p>DRIPPING SPRINGS, TX</p> <p>(512) 565-0875</p> <p>WWW.TEXASMETALTANKS.COM</p>	<p>A0</p>	<p>SCALE: 1:35</p> <p>PAGE: 1</p> <p>DRAFTER: BRE</p> <p>AUGUST 2022</p>